# SPECIFICATION FOR REPAIR CLAMPS

Revised on 26-07-2018

## TABLE OF CONTENTS

1	Scope	6r – 2
2	General Requirements	6r – 2
3	Dimensions	6r – 4
4	Markings	6r – 4

NWSDB/ Specification for Repair Clamps CAPC : MPC : DPC : PPC : RPC :- June 2013

6r-1

#### **Specification for Repair Clamps**

#### 1. **SCOPE**

This specification covers single band repair clamps to repair holes, cracks or other damages on uPVC pipes.

#### 2. GENERAL REQUIREMENTS

#### **Single Band Repair Clamps**

- a. Band or shell shall be of the O.D size range and length specified. Band shall be of Type 304 stainless steel.
- b. Bolt retainer assembly or lugs shall be of a type 304 stainless steel and of a non-welded design. Lugs may be cast, forged or cold formed of type 304 stainless steel, and may include a high impact polycarbonate plastic, non corrosive retainer. Lug design shall be such that the band fully compresses the gasket to the complete working width of the repair clamp without deformation of the band.
- c. All nuts and bolts shall be 304- stainless steel and coated with an anti-seize coating such as a non-seize zinc coating to prevent galling.
- d. Waffle Gasket or Seal shall provide a 360° sealing surface and of such size and shape to provide and adequate compressive force against the pipe after assembling to affect a positive seal under all combinations of joint and gasket tolerances. Materials shall be of elastomeric materials conform to BSEN 681-1 and material properties conforming to Table 2 of BSEN 681-1.A heavy gauge Type 304 stainless Steel bridge plate shall be vulcanized into the gasket to span the lug area.
- e. Repair Clamps shall be suitable for usage up to 40° C temperature without any effect to the installed life of the product.
- f. Pressure shall be of 16bar for working and 24bar for test pressures.
- g. The Bidder shall provide ISO 9001: 2015 Quality Management System requirement certificate for Quality Assurance for the goods manufacturing factory from an accredited agency for All repair clamps. Accredited Agency shall be a member of International Accredited Forum (IAF) and shall have the authority for the accreditation of mentioned goods in their scope of accreditation. Scope of the production shall be clearly specified in the certificate. Manufacturer shall maintain the validity of this certificate during the supply and delivery of the materials for contract Period. If the supply is


made from several factories, ISO 9001 : 2015 certificates for quality management system requirement shall be submitted for each factory. This certificate shall clearly indicate the location of the place of manufacture of pipes, fittings and accessories, etc.

h. Full details of the repair clamps should be given in schedule of particulars.

CAPC : MPC : DPC : PPC : RPC :- June 2013 6r-3 Revised on 26-07-2018

## 3. **<u>DIMENSIONS</u>**

Dimensions of repair clamps shall comply with Table-01.

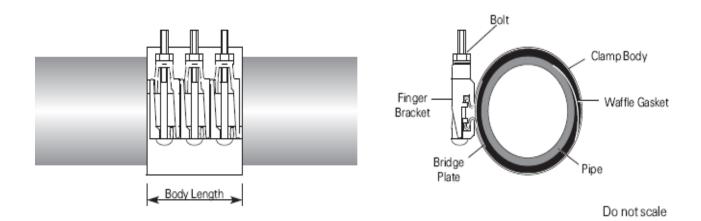

uPVC Pipe Size	Clamp Range	Clamp Body length (Minimum)	Number of Bolts	Weight (Kg)
63mm	60-70	190mm	3	3.90
75mm	70-80	190mm	3	4.00
90mm	85-95	190mm	3	4.10
110mm	105-115	190mm	3	4.20
125mm	120-130	190mm	3	4.40
140mm	135-145	190mm	3	4.60
160mm	155-165	190mm	3	4.80
225mm	220-230	190mm	3	5.40
280mm	275-285	190mm	3	5.80

<u>Table – 01</u>

### 4. MARKINGS

Markings of the repair clamps should include the information listed in table -8 of ISO 4422-4

NWSDB/ Specification for Repair Clamps CAPC : MPC : DPC : PPC : PPC : June 2013